


FLUSH FLOOR BOX SPECIFICATION:

- ① SYMBOL = ONE WALKER RESOURCE PFD FLOOR BOX (4 COMPARTMENT)
 A EACH FLOOR BOX TO ACCOMMODATE FOUR DUPLEX RECEPTACLES
 TWO DUPLEX RECEPTACLES PER COMPARTMENT - TOTAL OF TWO
 COMPARTMENTS PER FLOOR BOX FOR POWER RECEPTACLES
 TWO REMAINING COMPARTMENTS SHALL BE FOR OWNER'S VOICE/DATA
 REQUIREMENTS. EACH VOICE/DATA COMPARTMENT SHALL BE INSTALLED
 WITH ONE-1" CONDUIT TO ABOVE CEILING.
 B EACH FLOOR BOX TO BE PROVIDED WITH VOICE/DATA/RECEPTACLE
 BRACKETS. CONTRACTOR TO PROVIDE RECEPTACLES FOR FLOOR BOX.
 PROVIDE VOICE/DATA JACKS, ETC. FOR FLOOR SOCKS.
 C BRASS ACTIVATION COVERPLATE WITH INSERT. PROVIDE EXACT TYPE INSERT TO MATCH
 EXISTING FLOOR COVERING TYPE.
 1. VERIFY WITH THE OWNER THE EXACT LOCATION OF ALL FLOOR BOXES BEFORE
 STARTING INSTALLATION. COORDINATE WITH OWNER FOR FURNITURE TYPE AND LOCATION.

SHEET NOTES:

- ① MOUNT RECEPTACLE AND DATA OUTLET AT 48" ABOVE FINISHED FLOOR.
 ② MOUNT RECEPTACLE BETWEEN TOP OF BASE CABINET AND BOTTOM OF WALL CABINET.
 ③ MOUNT RECEPTACLE 5" BELOW WALL CABINET FOR CONNECTION TO MIDWAVE.
 ④ GROUND BAR, SEE DETAIL THIS SHEET.
 ⑤ MOUNT RECEPTACLE AND DATA OUTLET BETWEEN TOP OF BASE CABINET AND BOTTOM OF WALL
 CABINET.
 ⑥ 3/4" CONDUIT FOR DATA CABLE.
 ⑦ PROVIDE SEPARATE NEUTRAL FOR EACH CIRCUIT IN OPEN OFFICE AREA, OR AS SHOWN.
 ⑧ CONTRACTOR TO LOCATE RECEPTACLE PER OWNERS REQUEST.
 ⑨ FIRE ALARM ANNUNCIATOR PANEL.
 ⑩ PROVIDE 4' X 8' X 3/4" THICK PLYWOOD BOARD. PAINT 2 COATS OF FIRE RESISTANT PAINT.
 ⑪ CEILING MOUNTED PROJECTOR.
 ⑫ RECEPTACLE & DATA OUTLET MOUNTED ABOVE CEILING AT PROJECTOR.
 ⑬ PROJECTION SCREEN MOUNTED AT CEILING.
 ⑭ CONTRACTOR TO PROVIDE & WIRE TRANSFORMER FOR URINAL
 ELECTRONIC AUTOMATIC FLUSH VALVES.
 ⑮ PROVIDE 2-4" CONDUITS FOR VOICE AND DATA SERVICES. COORDINATE
 FINAL TERMINATION OF CONDUITS WITH VOICE AND DATA PROVIDERS.

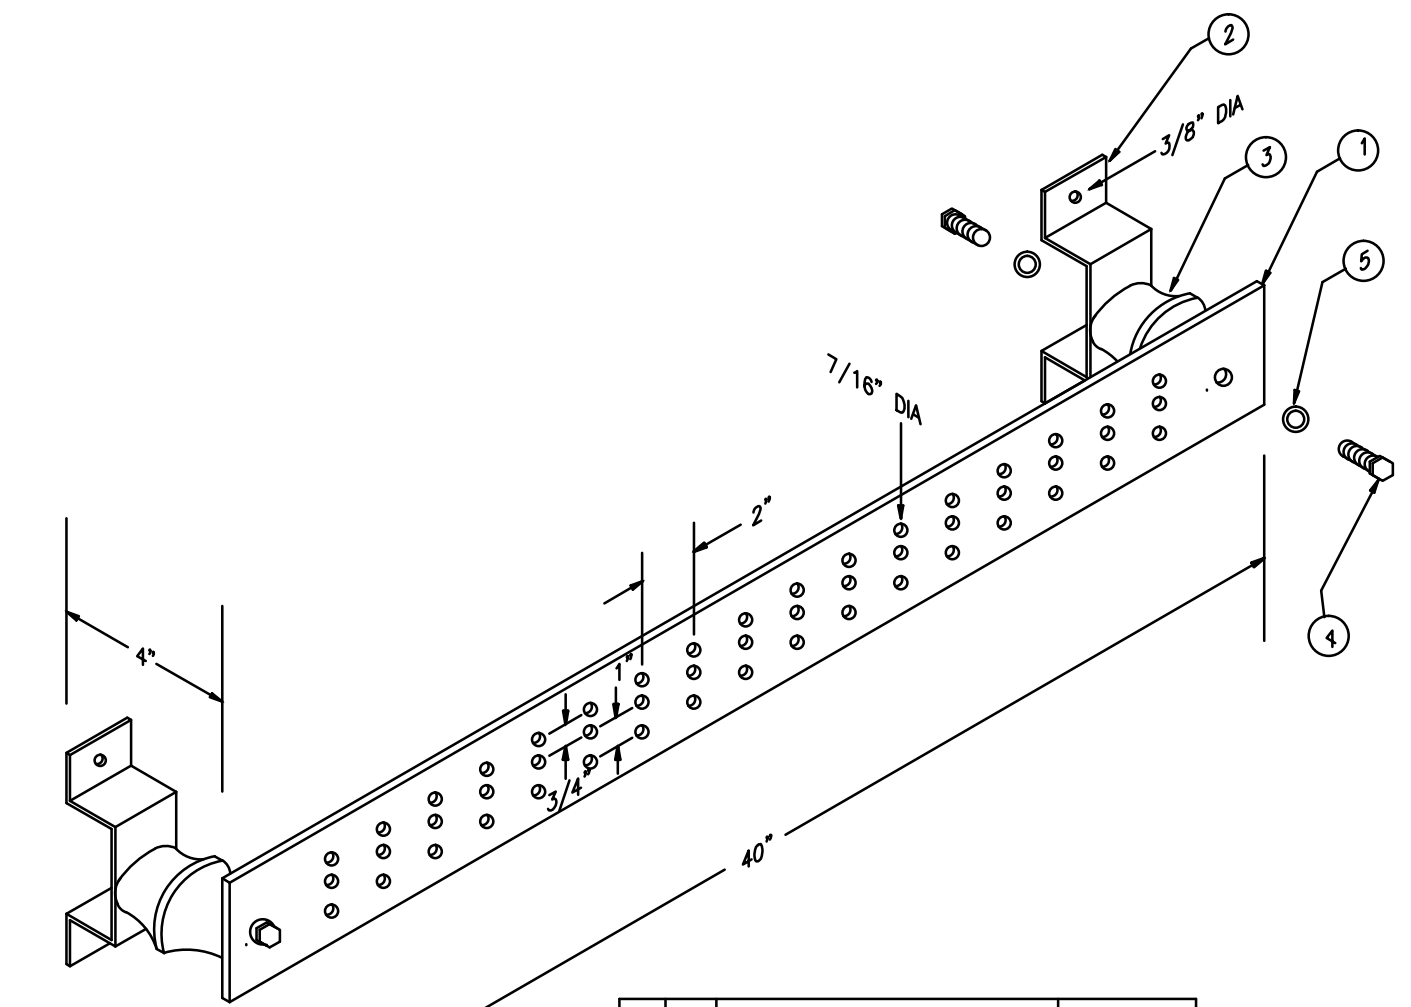

NO.	QTY.	DESCRIPTION	PART NO.
1	1	GROUND BAR	B-6412
2	2	WALL MOUNTING BRACKETS	A-6056
3	2	INSULATORS	3061-4
4	4	BOLTS, 5/3-11 1" H.H.C.S.	3012-1
5	4	5/8" LOCK WASHERS	3015-8

PART NUMBERS FOR THE GROUND BAR SHOWN REFER TO NEWTON INSTRUMENT UNIT #A10864. SEE SPECS.

ENLARGED OFFICE FLOOR PLAN — RECEPTACLE, SIGNAL, DATA
 SCALE: 1/8" = 1'-0"

DATE	REVISION	BY
NOV 11	VALUE ENGINEERING RE-DESIGN DOCUMENT	

PROJECT NO. 8529-02
DESIGNED BY SHT
DRAWN BY JVB
CHECKED BY TBW
REVIEWED BY SHT
DATE JULY 2011
SCALE AS NOTED

mse
 OF KENTUCKY, INC.
 Engineers
 Architects
 Planners
 Phone: (859)223-5684
 Fax: (859)223-2807
 624 Wellington Way
 Lexington, KY 40503
 www.mseinc.com

