


TYPICAL SLAB DETAIL AT EXTERIOR PIER


TYPICAL SLAB DETAIL AT EXTERIOR PIER

TYPICAL SLAB DETAIL AT INTERIOR PIER


TYPICAL DETAILS

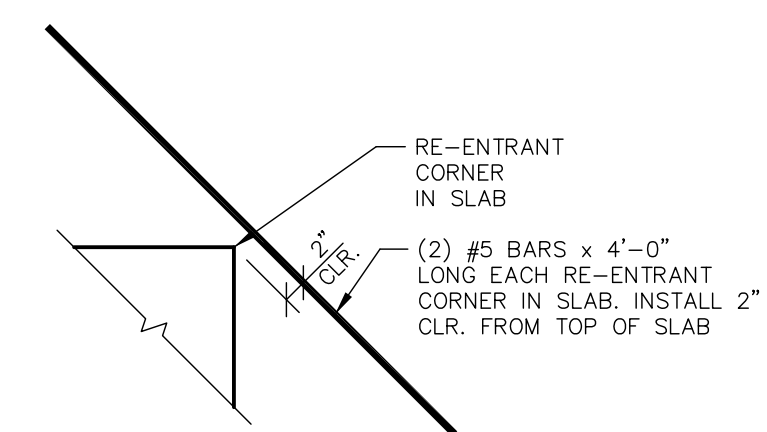


SLAB RE-ENTRANT CORNER

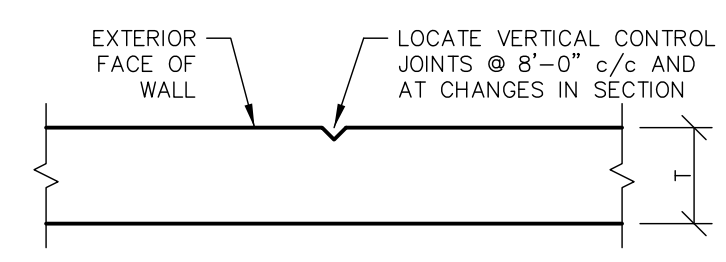


WALL CONTROL JOINT

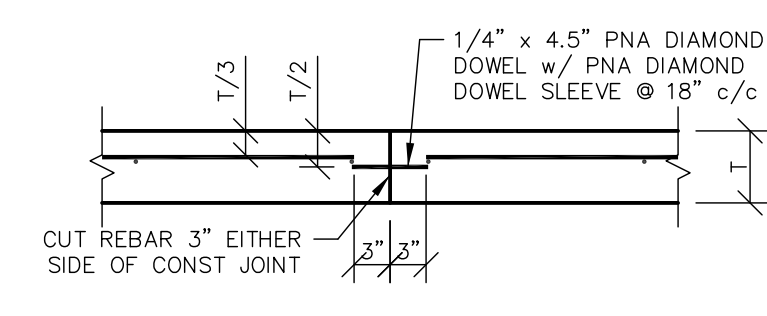

SLAB CONSTRUCTION JOINT

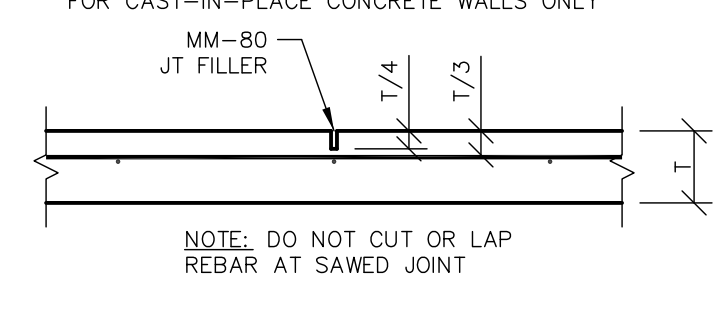

SLAB SAWED JOINT

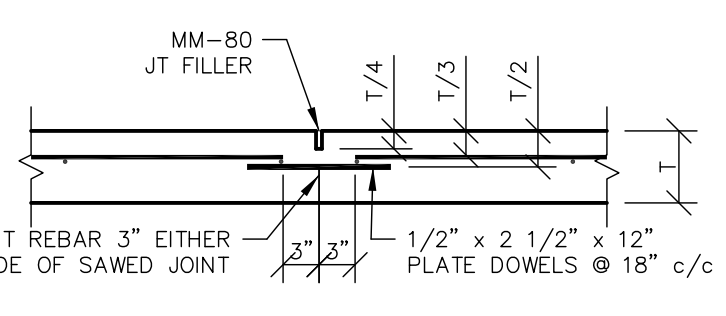

SLAB SAWED JOINT

TYP. DETAILS


PLAN NORTH
SLAB-ON-GROUND PLAN

FLOOR FINISH SHALL BE F1=25 F1=25 MIN. OVERALL
F1=24 F1=15 MIN. LOCAL

FOR INTERIOR SLABS-ON-GROUND COARSE AGGREGATES SHALL BE GRADED SUCH THAT NOT MORE THAN 18 PERCENT NOR LESS THAN 8 PERCENT OF THE TOTAL AGGREGATE IS RETAINED ON THE 3/4", 1/2", 3/8" AND NUMBER 4 SIEVES. THE STRUCTURAL ENGINEER MAY WAIVE THESE REQUIREMENTS IF HE DEEMS THEM NOT PRACTICAL.

- C.J. DENOTES SLAB CONSTRUCTION JOINT

- TYPICAL PLANT SLAB UNLESS NOTED OTHERWISE
- SLAB TYPE 2: 6" THICK CONCRETE SLAB ON 10 mil POLYETHYLENE VAPOR RETARDER ON 8" CRUSHED DENSE GRADE AGGREGATE w/ #3 BARS @ 18" c/c EACH WAY (SINGLE LAYER) (SAWED-JOINT SPACING = 15'-0" x 15'-0" MAX). CAPACITIES ARE LISTED BELOW: 1,500 psf UNIFORM LOAD, OR FORK TRUCK w/ 3 milon LIFTING CAPACITY BACK-TO-BACK-TO-BACK-TO-BACK RACK POST LOAD OF 5.0 kips (20 kips TOTAL)
 - SLAB TYPE 5: 4" THICK CONCRETE SLAB ON 10 mil POLYETHYLENE VAPOR RETARDER ON 8" CRUSHED DENSE GRADE AGGREGATE w/ 4#4-W/W/W W.W.M. (SINGLE LAYER) (NO SAW-CUTS). LOADING: ADMINISTRATIVE AREA STANDARD.
 - DENOTES EQUIPMENT FOUNDATION. REFER TO PS DRAWINGS.

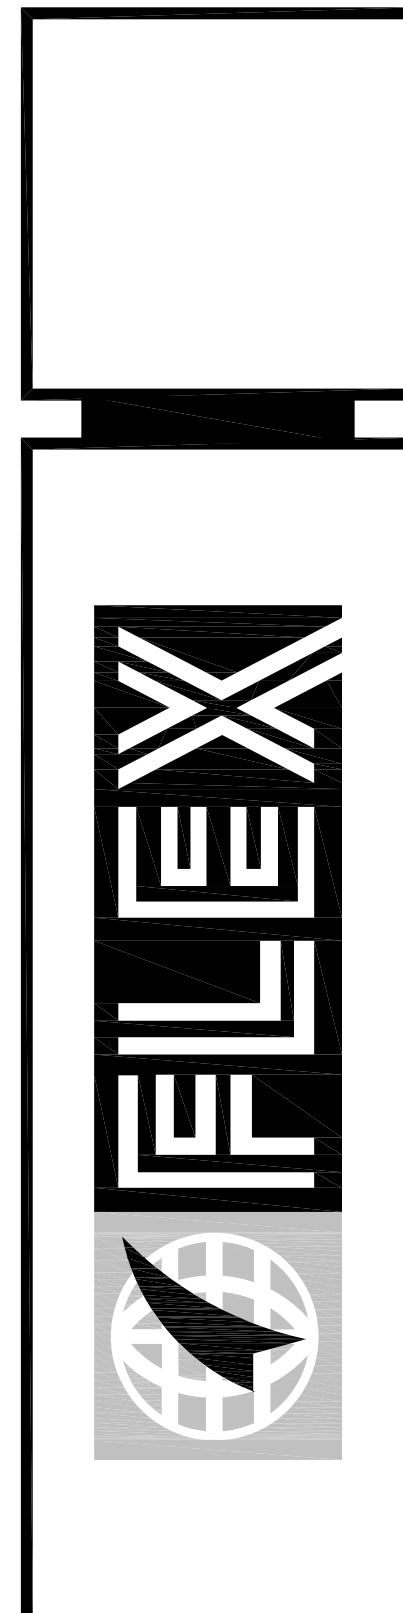

FLEX FILMS (USA) INC.
1221 NORTH BLACK BRANCH ROAD
ELIZABETHTOWN, KENTUCKY 42702

PROJECT L-12 BOPET U.S.A.

DATE	REVISION
07-21-2011	REVISION NUMBER ONE
01-04-12	REVISION NUMBER 3

PROJECT NO. 8529-02
DESIGNED BY EFH
DRAWN BY GPT EFH
CHECKED BY FH
REVIEWED BY
DATE JULY 2011
SCALE AS NOTED

nse Engineers
Architects
Planners
OF KENTUCKY, INC.

Phone: (609)223-8694
Lexington, KY 40523
Fax: (609)223-8697
www.nseinc.com

DRAWING NO.
UFL-L12
S-109

SLAB-ON-GROUND PLAN